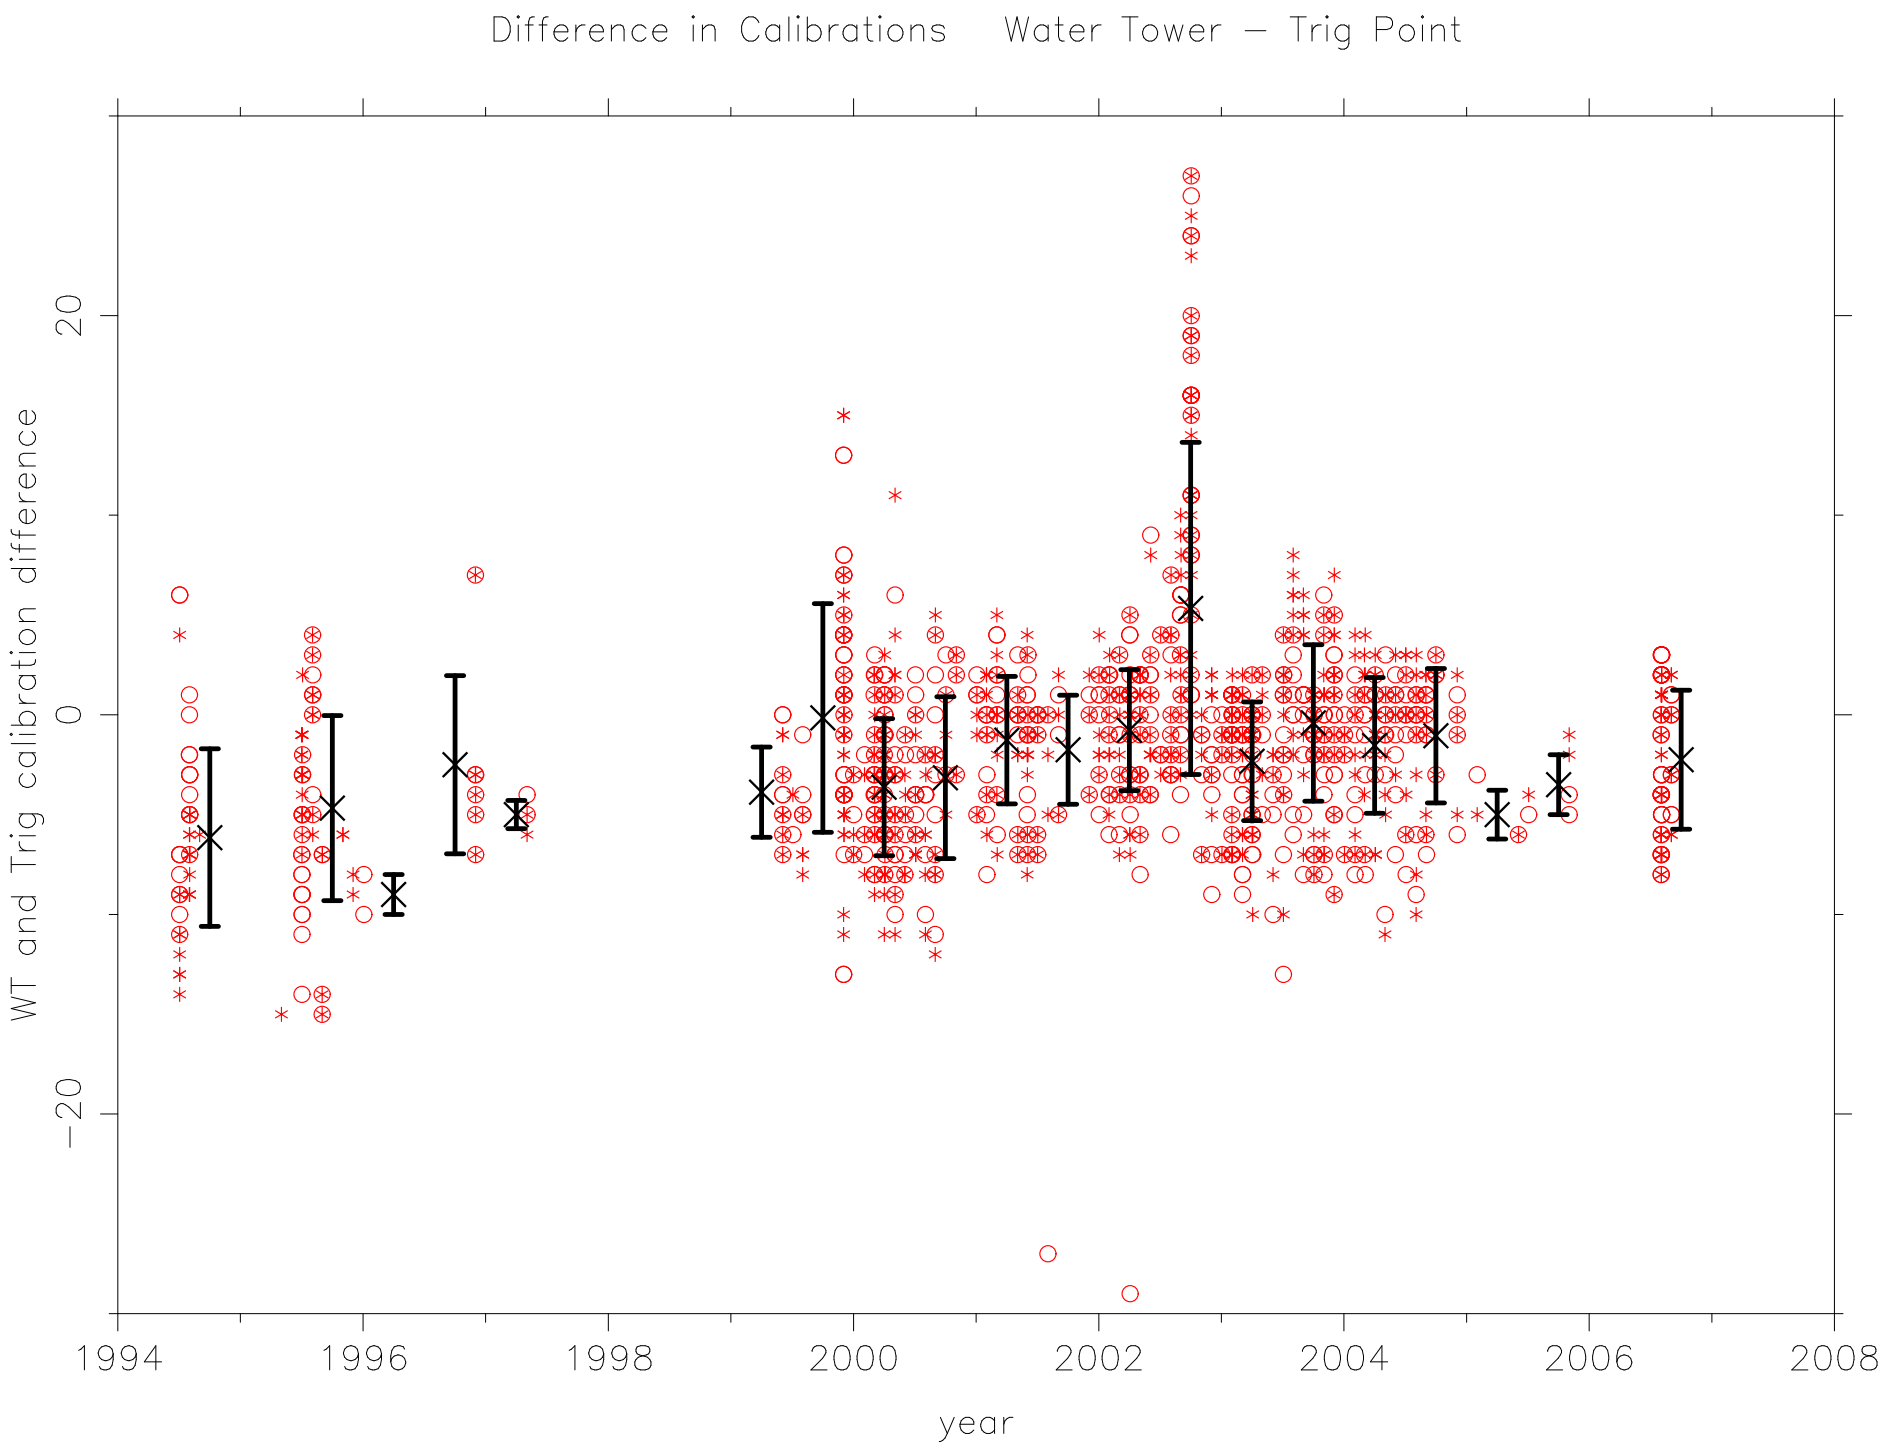
Difference in Calibrations Water Tower – Trig Point
WT and Trig calibration difference
20
0
−20
1994
1996
1998
2000
2002
2004
2006
2008
year